

# NEON ENERGY COMPUTER SIMULATION REPORT

## SCOPE OF WORK

ULTRA SLIDING WINDOW - NFRC 100/200/500

## REPORT NUMBER

P2837.01-116-45 R1

## TEST DATE

11/30/22

## ISSUE DATE

11/30/22

## REVISION DATE

02/27/23


## PAGES

28

## DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-4044 (04/11/22)

©2017 INTERTEK

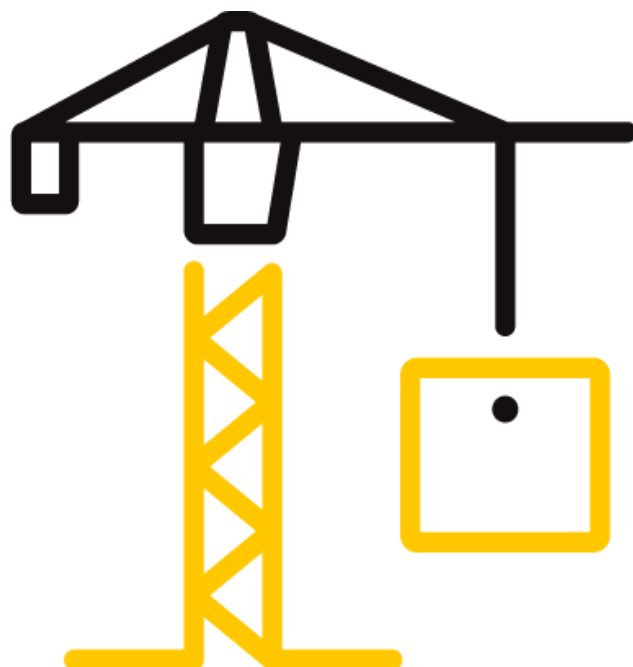



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
www.intertek.com/building

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### REPORT ISSUED TO

#### NEON ENERGY

23 Corporate Plaza

Suite 150

Newport Beach, California 92660

### SECTION 1

#### SUMMARY

#### SERIES/MODEL: Ultra Sliding Window

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted to perform U-Factor, Solar Heat Gain Coefficient, Visible Transmittance and Condensation Resistance simulations in accordance with the National Fenestration Rating Council (NFRC).

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends five years after the test date. Test records, such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation, will be retained for the entire test record retention period.

FOR INTERTEK B&C:

**COMPLETED BY:** Megan Yingst

**TITLE:** Simulation Technician

**SIGNATURE:**

**DATE:** 02/27/23

MMY:mmY

**REVIEWED BY:** Eric S. Leitner

**TITLE:** Manager - Simulations  
and Thermal Testing, SIRC

**SIGNATURE:**

**DATE:** 02/27/23

---

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### SECTION 2

#### TEST METHODS

The products were evaluated in accordance with the following:

***ANSI/NFRC 100-2020, Procedure for Determining Fenestration Product U-Factors***

***ANSI/NFRC 200-2020, Procedure for Determining Fenestration Product Solar Heat Gain Coefficient and Visible Transmittance at Normal Incidence***

***NFRC 500-2017, Procedure for Determining Fenestration Product Condensation Resistance Values***

*\*Condensation Resistance results obtained from this procedure are for controlled laboratory conditions and do not include the effects of air movement through the specimen, solar radiation, and the thermal bridging that may occur due to the specific design and construction of the fenestration system opening.*

Ratings values included in this report are for submittals to an NFRC-licensed IA and are not meant to be used directly for labeling purposes. Only those values identified on a valid Certificate of Authorization (CA) by an NFRC accredited Inspection Agency (IA) are to be used for labeling purposes. The ratings values were rounded in accordance with NFRC 601, NFRC Unit and Measurement Policy.

Intertek B&C is an NFRC accredited simulation laboratory and all simulations were conducted in full compliance with NFRC approved procedures and specifications. The values included in this report are not considered in compliance with ANSI/NFRC 100, ANSI/NFRC 200, and/or NFRC 500 unless the associated validation test requirements have been satisfied, as applicable.

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### SECTION 3

#### TEST PROCEDURE

The total product, including specific frame, spacer, and glass details, was modeled using NFRC approved software.

<b>FRAME AND EDGE MODELING</b>	THERM 7.4.4
<b>CENTER-OF-GLASS MODELING</b>	WINDOW 7.4.14
<b>TOTAL PRODUCT CALCULATIONS</b>	WINDOW 7.4.14
<b>SPECTRAL DATA LIBRARY</b>	IGDB 90.0

#### Modeling Assumptions / Technical Interpretations

Any modeling assumptions and technical interpretations required to model this product are listed below.

- 1) To prevent air infiltration, tape was applied to all interior sash crack locations.
- 2) TVS-1003 and TVS-1005 frame options were grouped per ANSI/NFRC 100-2020, Section 4.2.1.H.ii. TVS-1005 is the group leader.
- 3) The anodized and painted aluminum finishes were grouped per ANSI/NFRC 100-2020, Section 4.2.1.L. The painted finish is the group leader.

### SECTION 4

#### SIMULATION SPECIMEN DESCRIPTION

<b>SERIES/MODEL</b>	Ultra Sliding Window
<b>PRODUCT TYPE</b>	Double Slider
<b>FRAME MATERIAL</b>	AT - Aluminum w/ Thermal Breaks
<b>SASH MATERIAL</b>	AT - Aluminum w/ Thermal Breaks
<b>STANDARD SIZE</b>	1500mm x 1200mm

**TEST REPORT FOR NEON ENERGY**

Report No: P2837.01-116-45 R1

Date: 02/27/23

**SECTION 4 (Continued)**
**SIMULATION SPECIMEN DESCRIPTION**

SPACER OPTIONS			
TYPE	PRIMARY SEAL	SECONDARY SEAL	CODE
Aluminum Spacer	Butyl Rubber	Butyl Rubber	A1-D
Thermix TX.N Plus Spacer	Butyl Rubber	Silicone	TS-D

GRID OPTIONS		
GRID SIZE	GRID TYPE	GRID PATTERN
None	-	-

REINFORCEMENT OPTIONS	
LOCATION	MATERIAL
None	-

GAS FILLING TECHNIQUE	
FILL TYPE	METHOD
90% Argon	Two-probe with concentration sensor

EDGE-OF-GLASS CONSTRUCTION	
INTERIOR CONDITION	EPDM gasket between glass and aluminum sash
EXTERIOR CONDITION	EPDM gasket between glass and aluminum sash

WEATHERSTRIPPING		
TYPE	QUANTITY	LOCATION
Finpile	2 rows	Sash Perimeter; Lock and Keeper Stiles
Finpile	1 row	Frame Perimeter

FRAME/SASH MATERIALS FINISH	
INTERIOR	Aluminum - Painted or Anodized
EXTERIOR	Aluminum - Painted or Anodized

VALIDATION MATRIX*	
PRODUCT LINE	REPORT NUMBER
None	-

\*These products are part of a validation matrix. Only one is required for validation testing.

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### SECTION 5

#### SPECIALTY PRODUCTS TABLE

The specialty products method allows the manufacturer to determine the overall product SHGC and VT for any glazing option. The center of glass SHGC and/or VT must be determined using WINDOW 7.4.14. The method calculates overall product SHGC and VT indexed on center of glass properties. All values used in the calculations are truncated to six decimal place precision.

	No Dividers	Dividers < 1	Dividers > 1
<b>SHGC0</b>	0.011900	0.014343	0.016628
<b>SHGC1</b>	0.616100	0.544403	0.477385
<b>VT0</b>	0.000000	0.000000	0.000000
<b>VT1</b>	0.604201	0.530060	0.460758

$$\text{SHGC} = \text{SHGC0} + \text{SHGCc} (\text{SHGC1} - \text{SHGC0})$$

$$\text{VT} = \text{VT0} + \text{VTc} (\text{VT1} - \text{VT0})$$

**TEST REPORT FOR NEON ENERGY**

Report No: P2837.01-116-45 R1

Date: 02/27/23

**SECTION 6**
**SIMULATION RESULTS**

TOTAL PRODUCT CALCULATIONS (Ultra Sliding Window)												
Option Number	Pane Thickness 1 (in)	Gap Width 1 (in)	Pane Thickness 2 (in)	Gap Width 2 (in)	Pane Thickness 3 (in)	Gap Width 3 (in)	Pane Thickness 4 (in)	Gap Fill	Low-e (Surface #)	Tint	Spacer	Grid Type
	U-Factor (Btu/Hr-Ft2-F)			Solar Heat Gain Coefficient (SHGC) Grids (None / <1 / >=1)				Visible Transmittance (VT) Grids (None / <1 / >=1)		Condensation Resistance (CR)		
1	No Foam: SNX50/ARG90/CLR (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.027(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.15				VT(N) 0.30		CR 38		
2	No Foam: SNX60/ARG90/CLR (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.17				VT(N) 0.36		CR 38		
3	No Foam: SN4023/ARG90/CLR (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.15				VT(N) 0.24		CR 38		
4	No Foam: SN51/ARG90/CLR (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.17				VT(N) 0.30		CR 38		
5	No Foam: SN7037/ARG90/CLR (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.022(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.22				VT(N) 0.42		CR 37		
6	No Foam: SN7037/ARG90/CLR (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.022(#2)	CL	A1-D	N
	U-Factor 0.49			SHGC(N) 0.22				VT(N) 0.42		CR 38		
7	No Foam: SNX50/ARG90/CG-Dry (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.027(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.14				VT(N) 0.29		CR 38		
8	No Foam: SNX50/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.027(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.15				VT(N) 0.29		CR 39		
9	No Foam: SNX60/ARG90/CG-Dry (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.17				VT(N) 0.35		CR 38		
10	No Foam: SNX60/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.026(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.18				VT(N) 0.35		CR 39		

**TEST REPORT FOR NEON ENERGY**

Report No: P2837.01-116-45 R1

Date: 02/27/23

**SECTION 6 (Continued)**
**SIMULATION RESULTS**

TOTAL PRODUCT CALCULATIONS (Ultra Sliding Window)												
Option Number	Pane Thickness 1 (in)	Gap Width 1 (in)	Pane Thickness 2 (in)	Gap Width 2 (in)	Pane Thickness 3 (in)	Gap Width 3 (in)	Pane Thickness 4 (in)	Gap Fill	Low-e (Surface #)	Tint	Spacer	Grid Type
	U-Factor (Btu/Hr-Ft2-F)			Solar Heat Gain Coefficient (SHGC) Grids (None / <1 / >=1)				Visible Transmittance (VT) Grids (None / <1 / >=1)		Condensation Resistance (CR)		
11	No Foam: SN4023/ARG90/CG-Dry (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.14				VT(N) 0.23		CR 38		
12	No Foam: SN4023/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.026(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.14				VT(N) 0.23		CR 39		
13	No Foam: SN51/ARG90/CG-Dry (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.026(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.16				VT(N) 0.30		CR 38		
14	No Foam: SN51/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.026(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.17				VT(N) 0.30		CR 39		
15	No Foam: SN7037/ARG90/CG-Dry (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.022(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.21				VT(N) 0.41		CR 38		
16	No Foam: SN7037/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.022(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.22				VT(N) 0.41		CR 39		
17	No Foam: SN7037/ARG90/CG-Dry (6MM/5MM) - 23MM IG											
	0.230	0.472	0.191					ARG90	0.022(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.21				VT(N) 0.41		CR 38		
18	No Foam: SN7037/ARG90/CG-Premium2T (6MM/4MM) - 22MM IG											
	0.230	0.472	0.151					ARG90	0.022(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.47			SHGC(N) 0.22				VT(N) 0.42		CR 39		
19	No Foam: SNX60/ARG90/CG-Dry (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.026(#2) / 0.200(#4)	CL	TS-D	N
	U-Factor 0.45			SHGC(N) 0.17				VT(N) 0.35		CR 38		
20	Foam: SNX50/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG											
	0.230	0.472	0.230					ARG90	0.027(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.46			SHGC(N) 0.15				VT(N) 0.29		CR 40		

# TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

## SECTION 6 (Continued)

### SIMULATION RESULTS

TOTAL PRODUCT CALCULATIONS (Ultra Sliding Window)												
Option Number	Pane Thickness 1 (in)	Gap Width 1 (in)	Pane Thickness 2 (in)	Gap Width 2 (in)	Pane Thickness 3 (in)	Gap Width 3 (in)	Pane Thickness 4 (in)	Gap Fill	Low-e (Surface #)	Tint	Spacer	Grid Type
	U-Factor (Btu/Hr-Ft2-F)			Solar Heat Gain Coefficient (SHGC) Grids (None / <1 / >=1)				Visible Transmittance (VT) Grids (None / <1 / >=1)			Condensation Resistance (CR)	
	21	Foam: SN7037/ARG90/CG-Premium2T (6MM/6MM) - 24MM IG										
	0.230	0.472	0.230					ARG90	0.022(#2) / 0.041(#3)	CL	TS-D	N
	U-Factor 0.46			SHGC(N) 0.22				VT(N) 0.41			CR 40	



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### SECTION 7

#### DRAWINGS / BILL OF MATERIALS

The drawings which follow have been reviewed by Intertek B&C and are representative of the simulation results reported herein. Any deviations are documented herein or on the drawings.


# Sliding Window



Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Yungert*

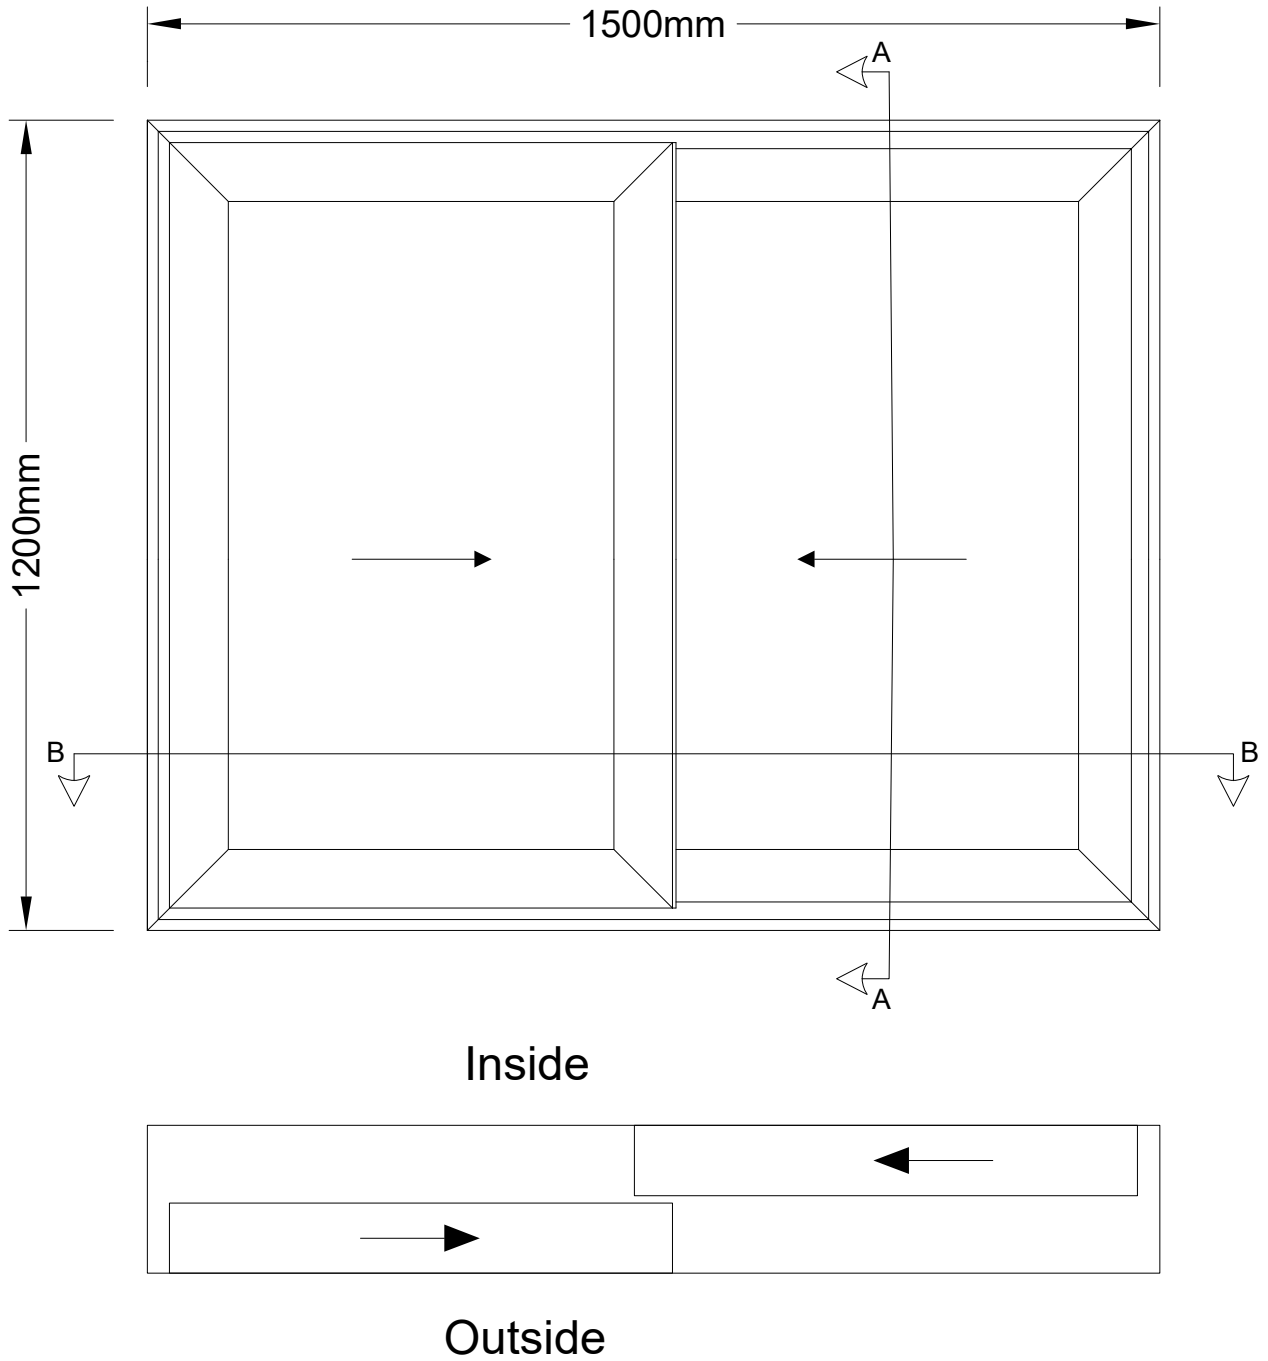


# Section A-A With XPS Specimen




Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Young*

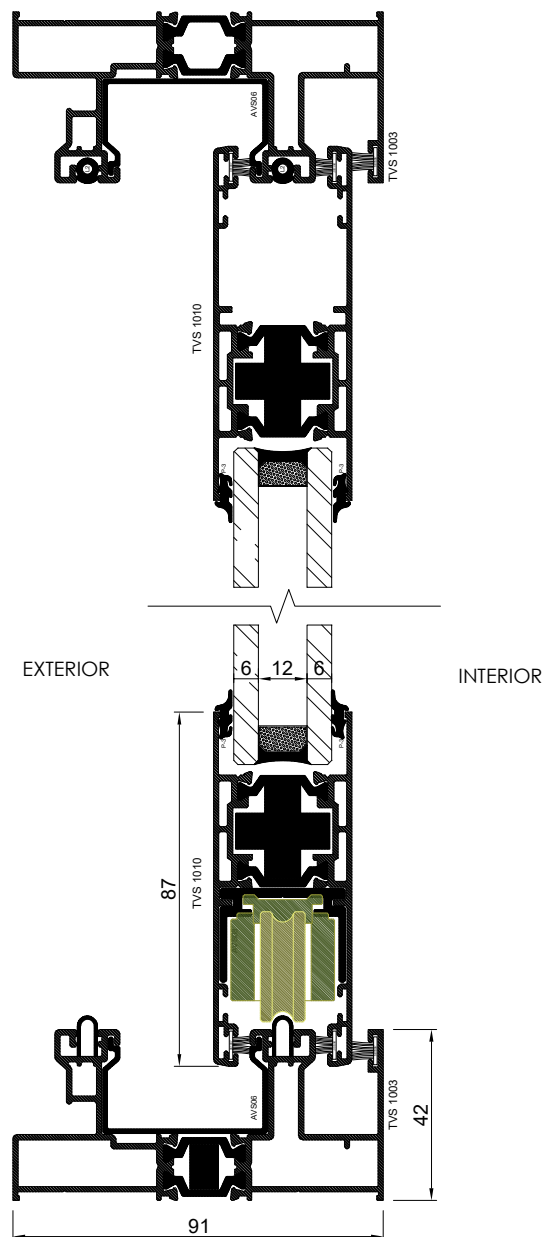


# Section A-A With Screen



Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Young*

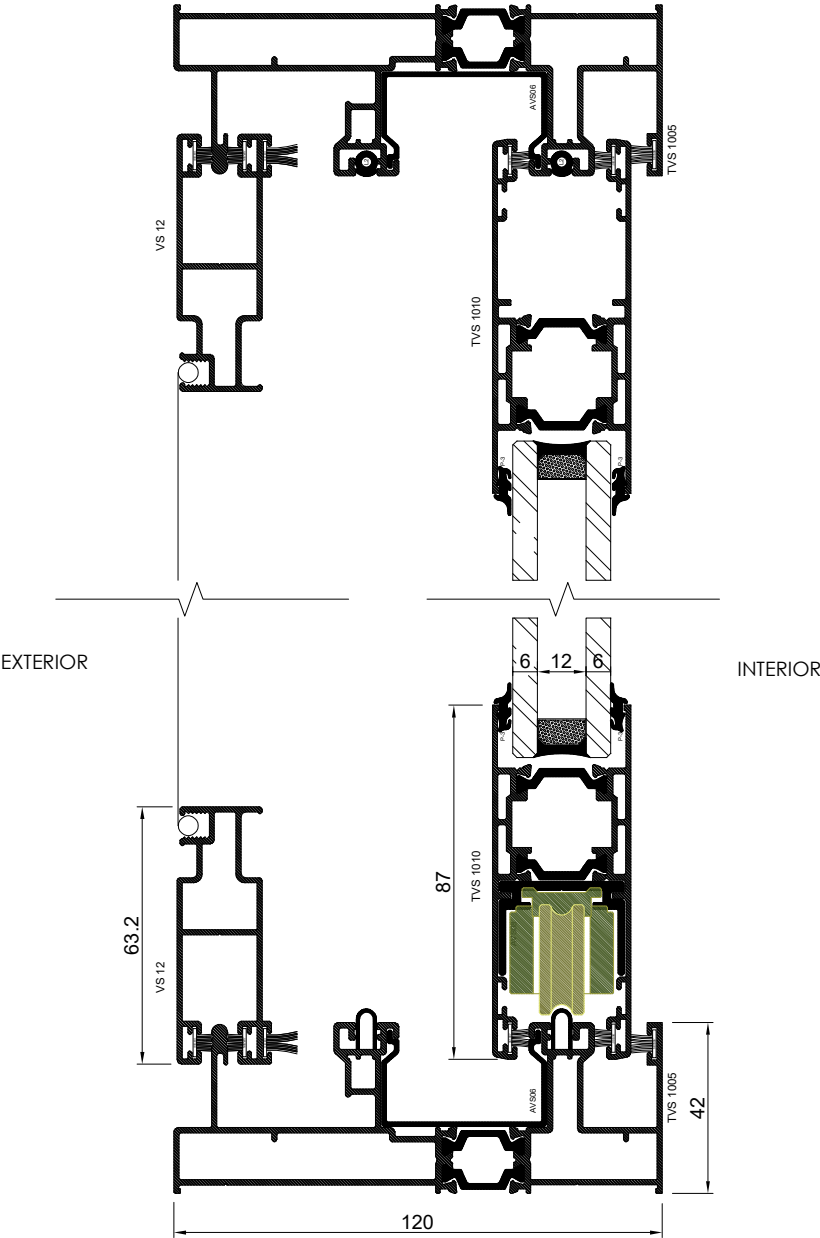


# Section A-A




Report #: P2837-116-45

Date: 11/30/2022


Verified by: *Megan M. Young*

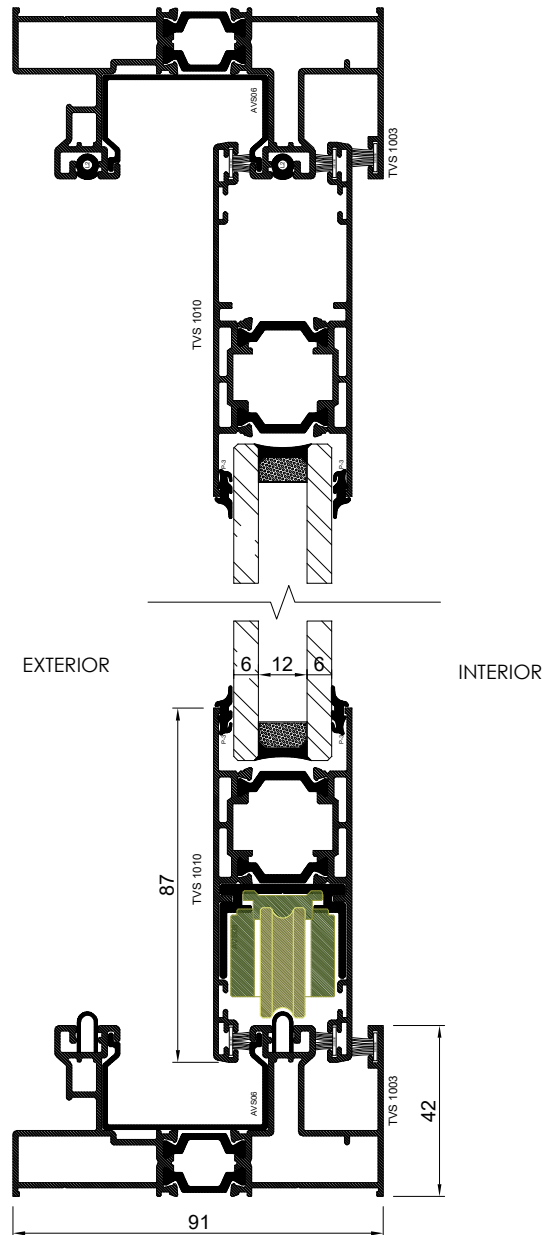

# Section B-B



Report #: P2837-116-45  
Date: 11/30/2022  
Verified by: *Megan M. Young*

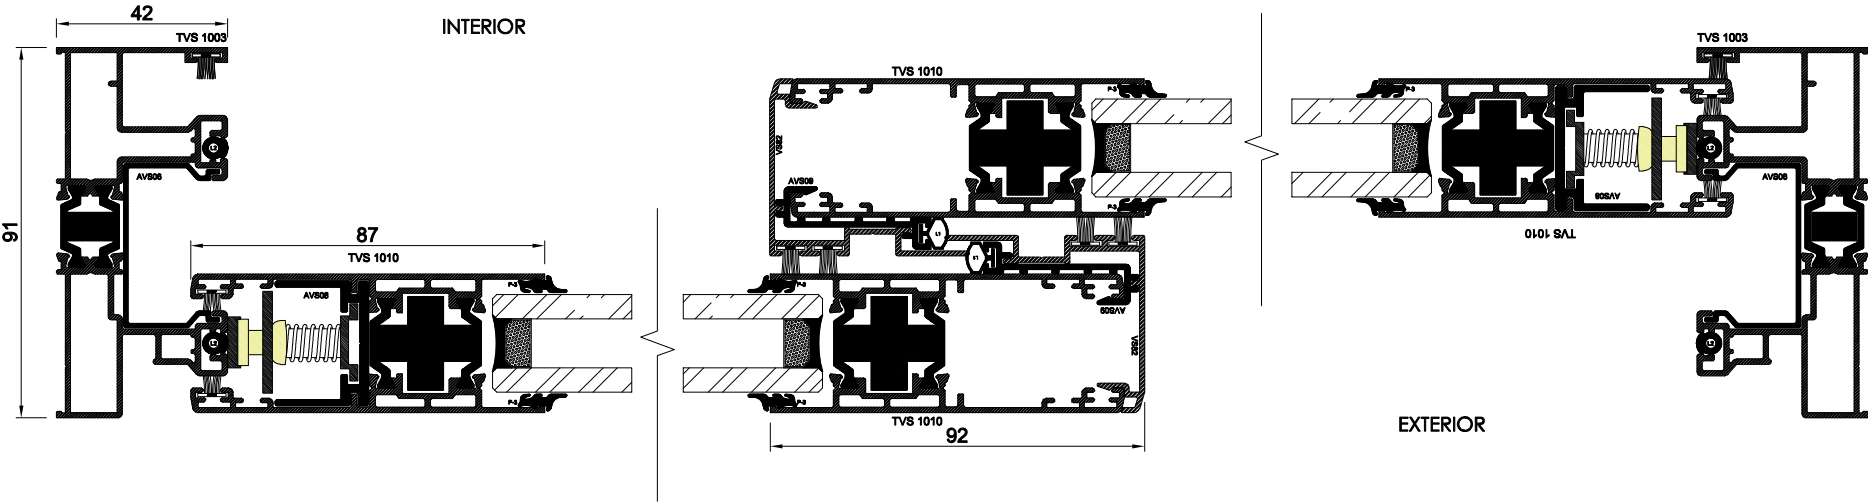


# Section B-B




Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Yungert*

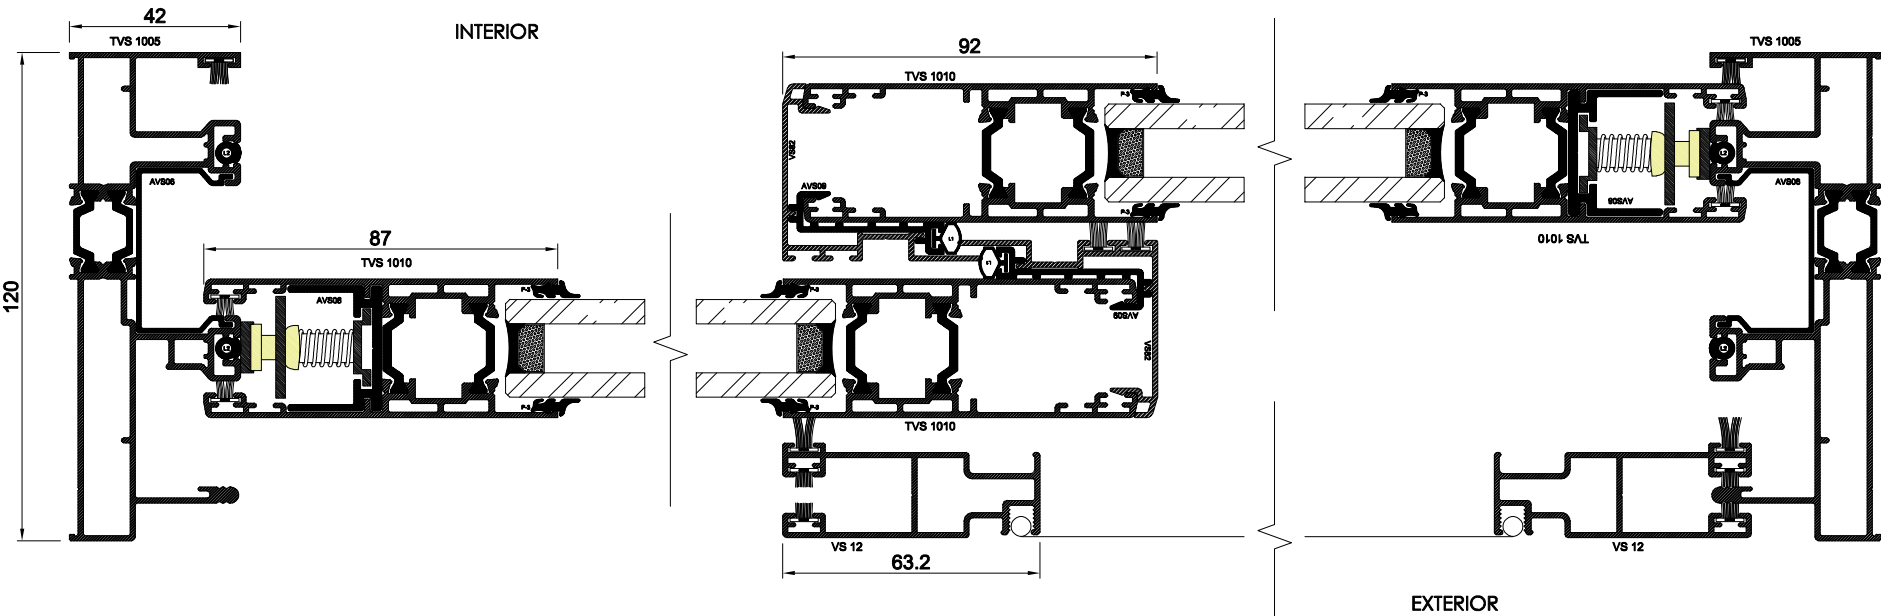


# Section B-B




Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Young*

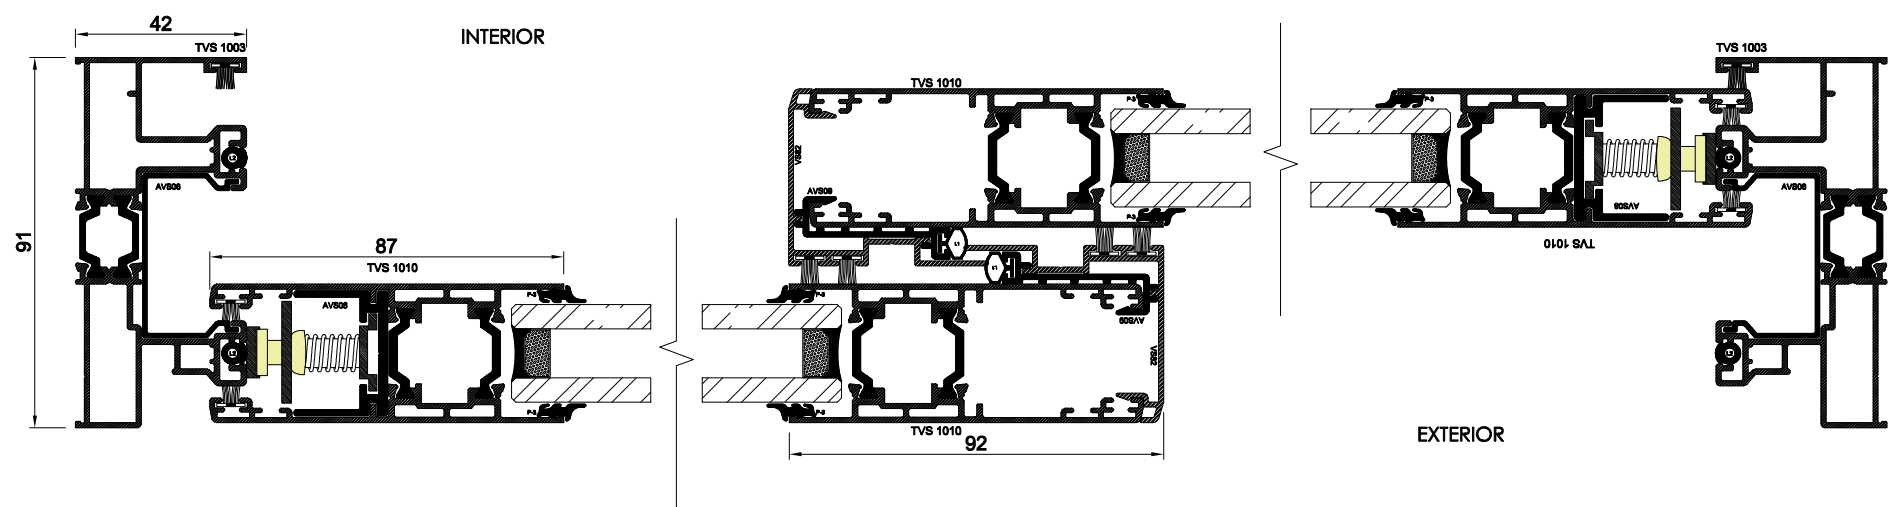


# Frame TVS-1003

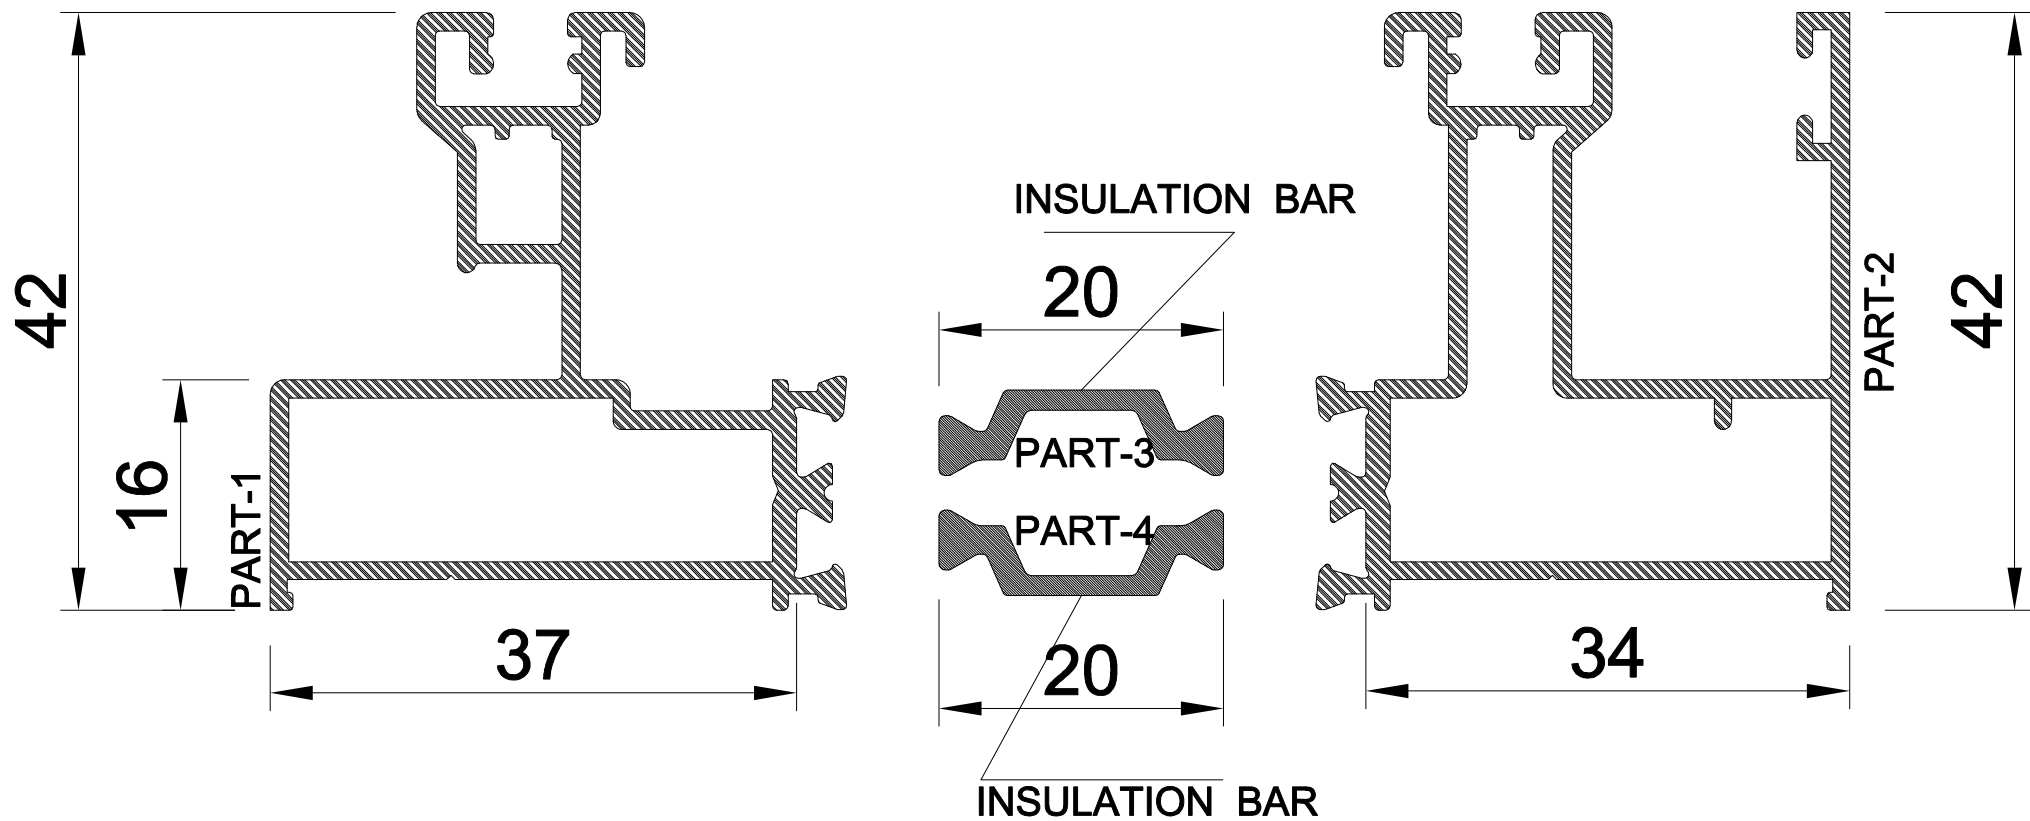


Parts 1&2 = Painted or Anodized Aluminum  
Parts 3&4 = Polyamide

## Frame TVS-1005

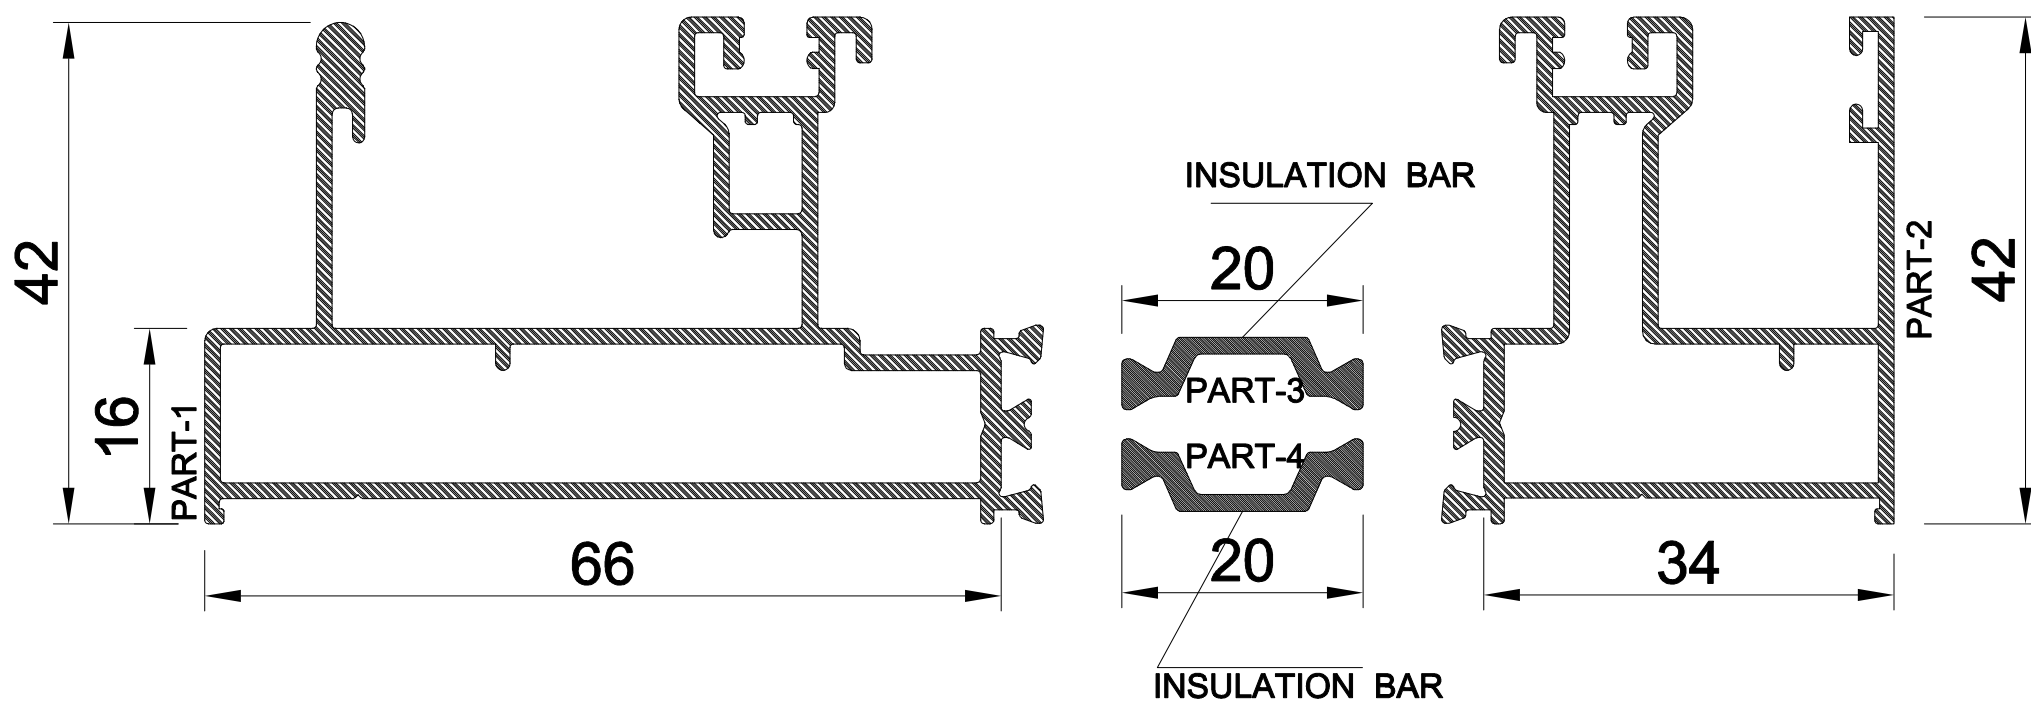


Parts 1&2 = Painted or Anodized Aluminum  
Parts 3&4 = Polyamide

# GASKETS (EPDM)




# GLAZING GASKETS (EPDM)

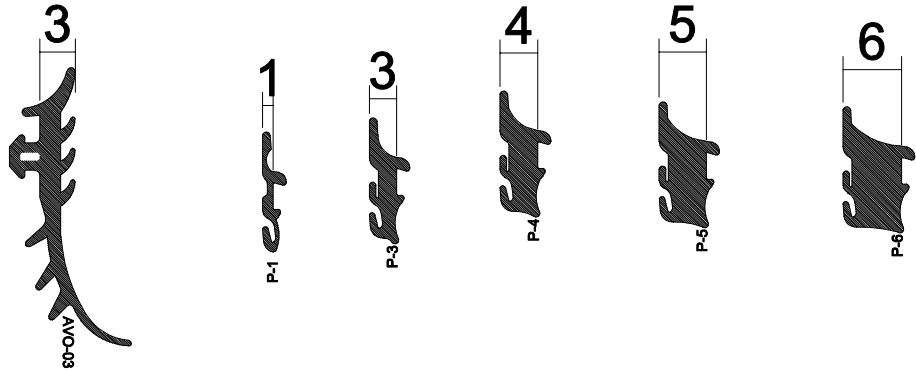


# Inox Profile

Material = Stainless Steel

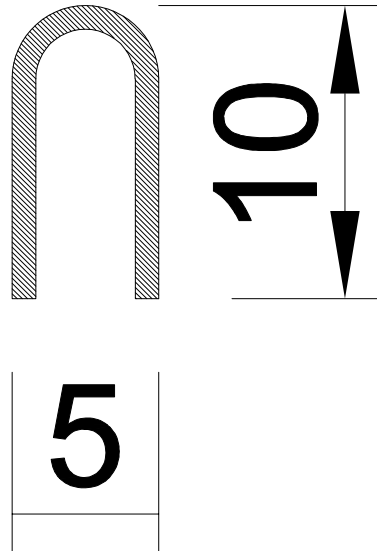

# Brush

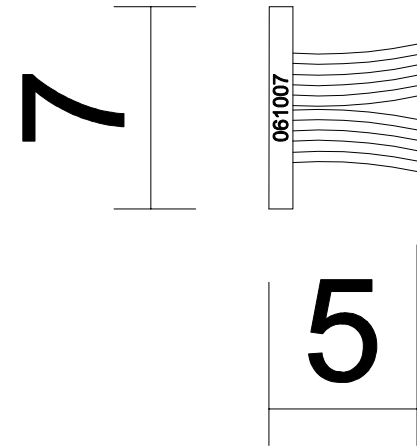




Report #: P2837-116-45

Date: 11/30/2022



Verified by: *Megan M. Young*

# Interlock VS-82

49

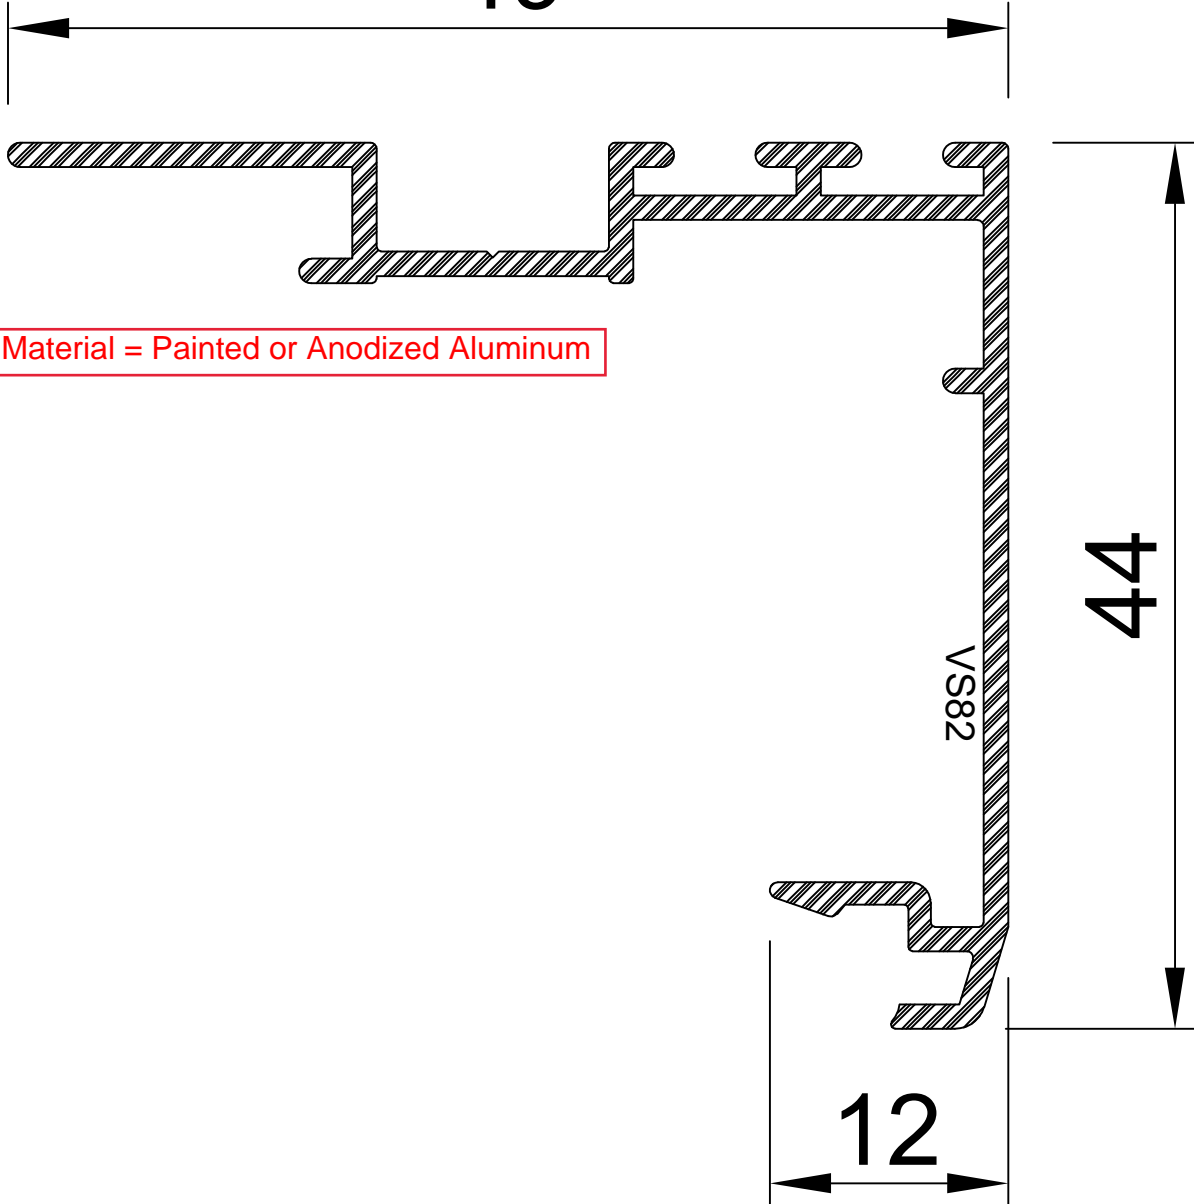

PVC

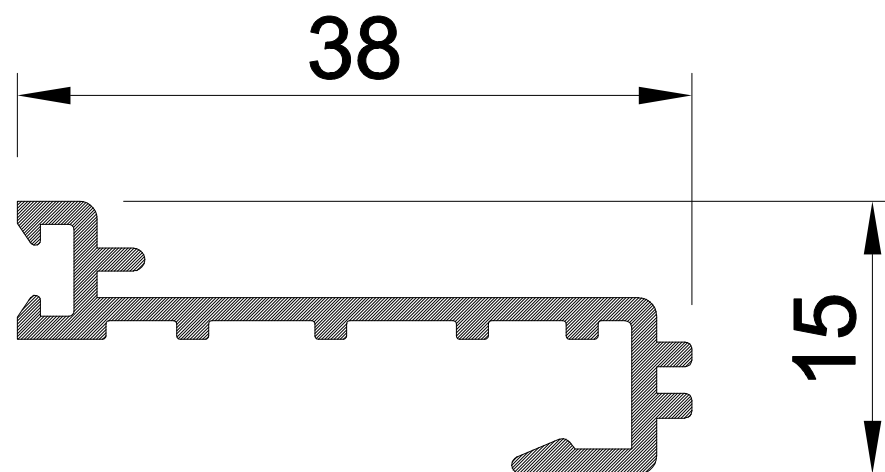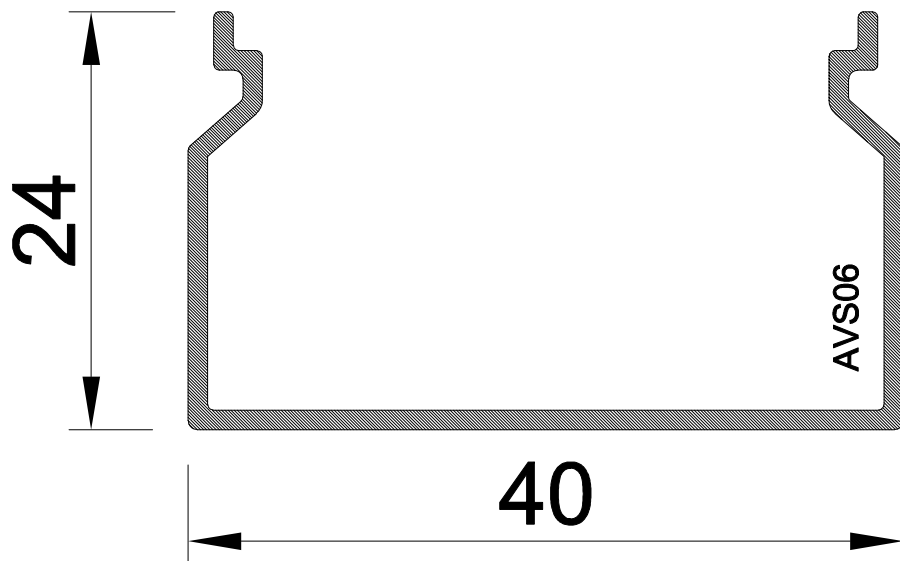

# Sash TVS-1010

87

PART-1

9

INSULATION BAR

22

PART-3

PART-4

22

INSULATION BAR

87

PART-2

9

6

6



Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Young*

Parts 1&2 = Painted or Anodized Aluminum  
Parts 3&4 = Polyamide


# Sash VS-21



Report #: P2837-116-45

Date: 11/30/2022

Verified by: *Megan M. Young*

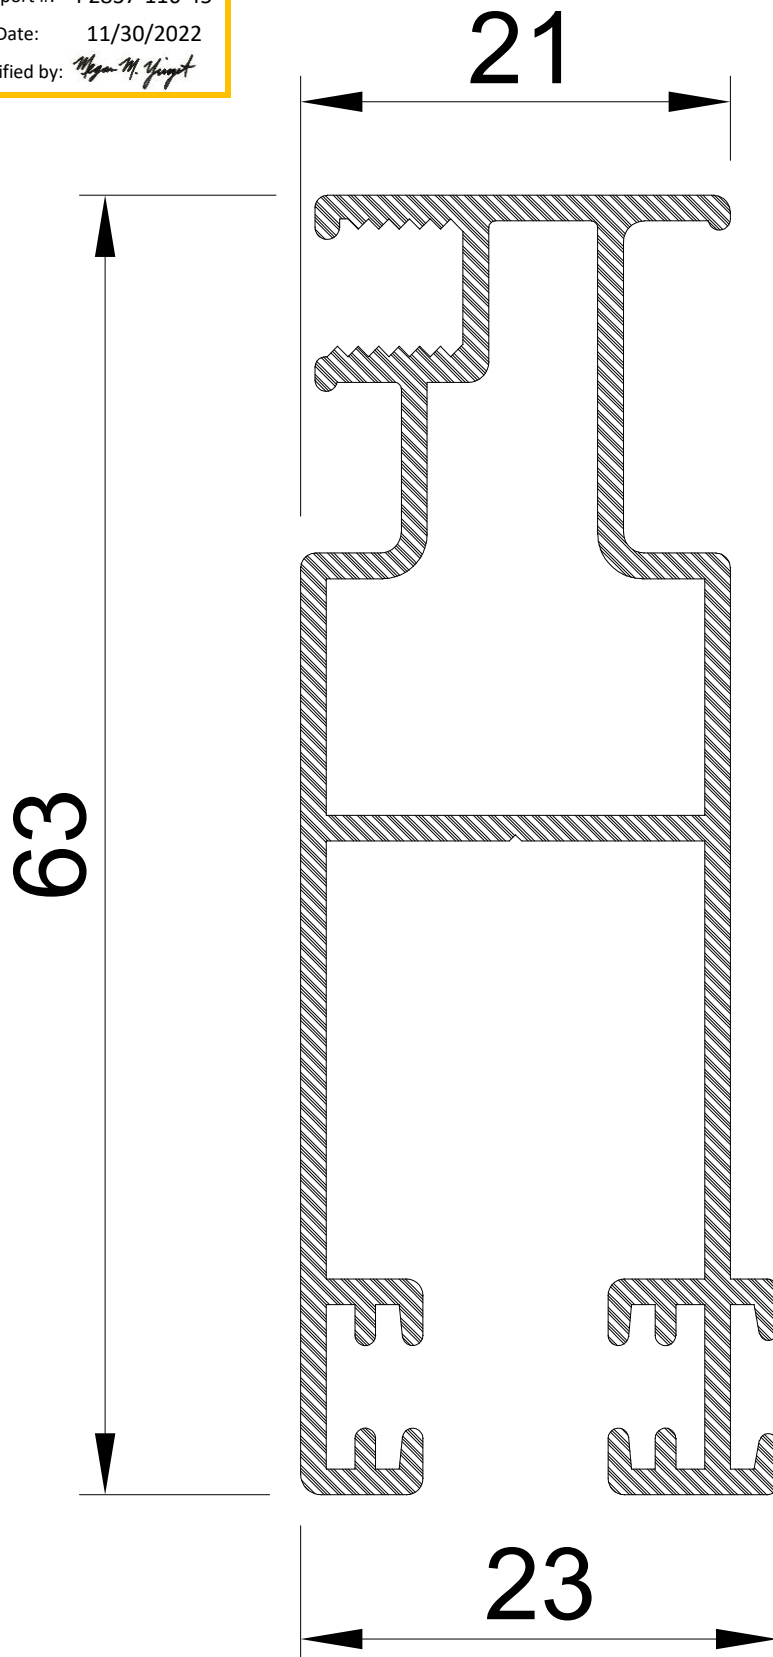


Material = Painted or Anodized Aluminum



Report #: P2837-116-45

Date: 11/30/2022


Verified by: *Megan M. Young*

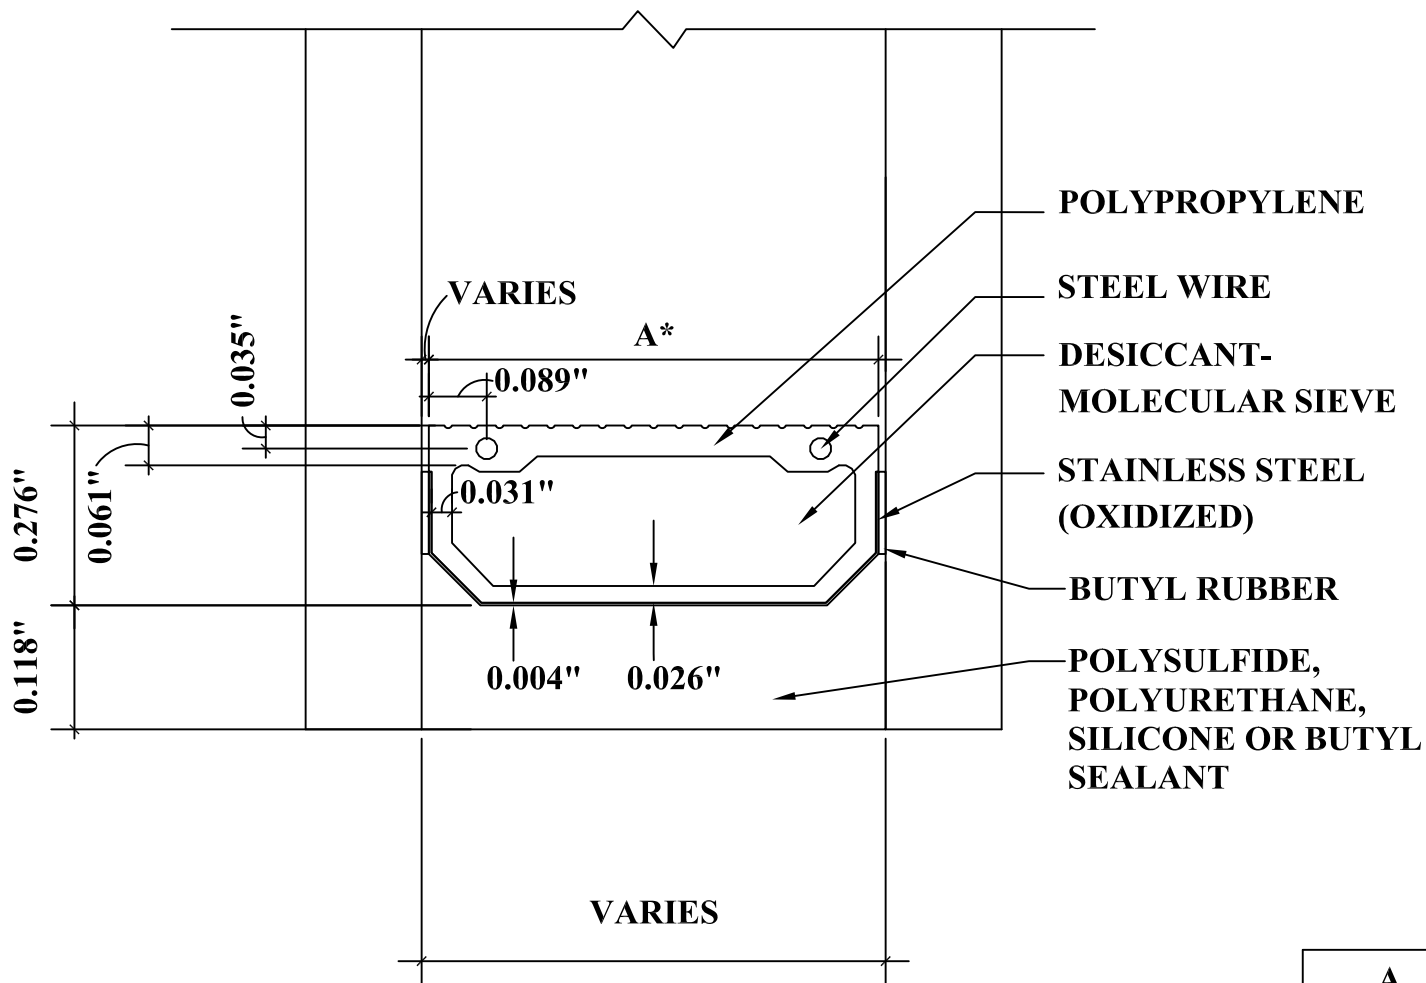

DETAIL FOR THERMAL MODELING OF  
ENSINGER THERMIX TX.N PLUS SPACER (TS-D)

**\*SPACER AVAILABLE IN 10 SIZES.**

A
0.945"
0.866"
0.787"
0.709"
0.630"
0.591"
0.551"
0.472"
0.394"
0.315"

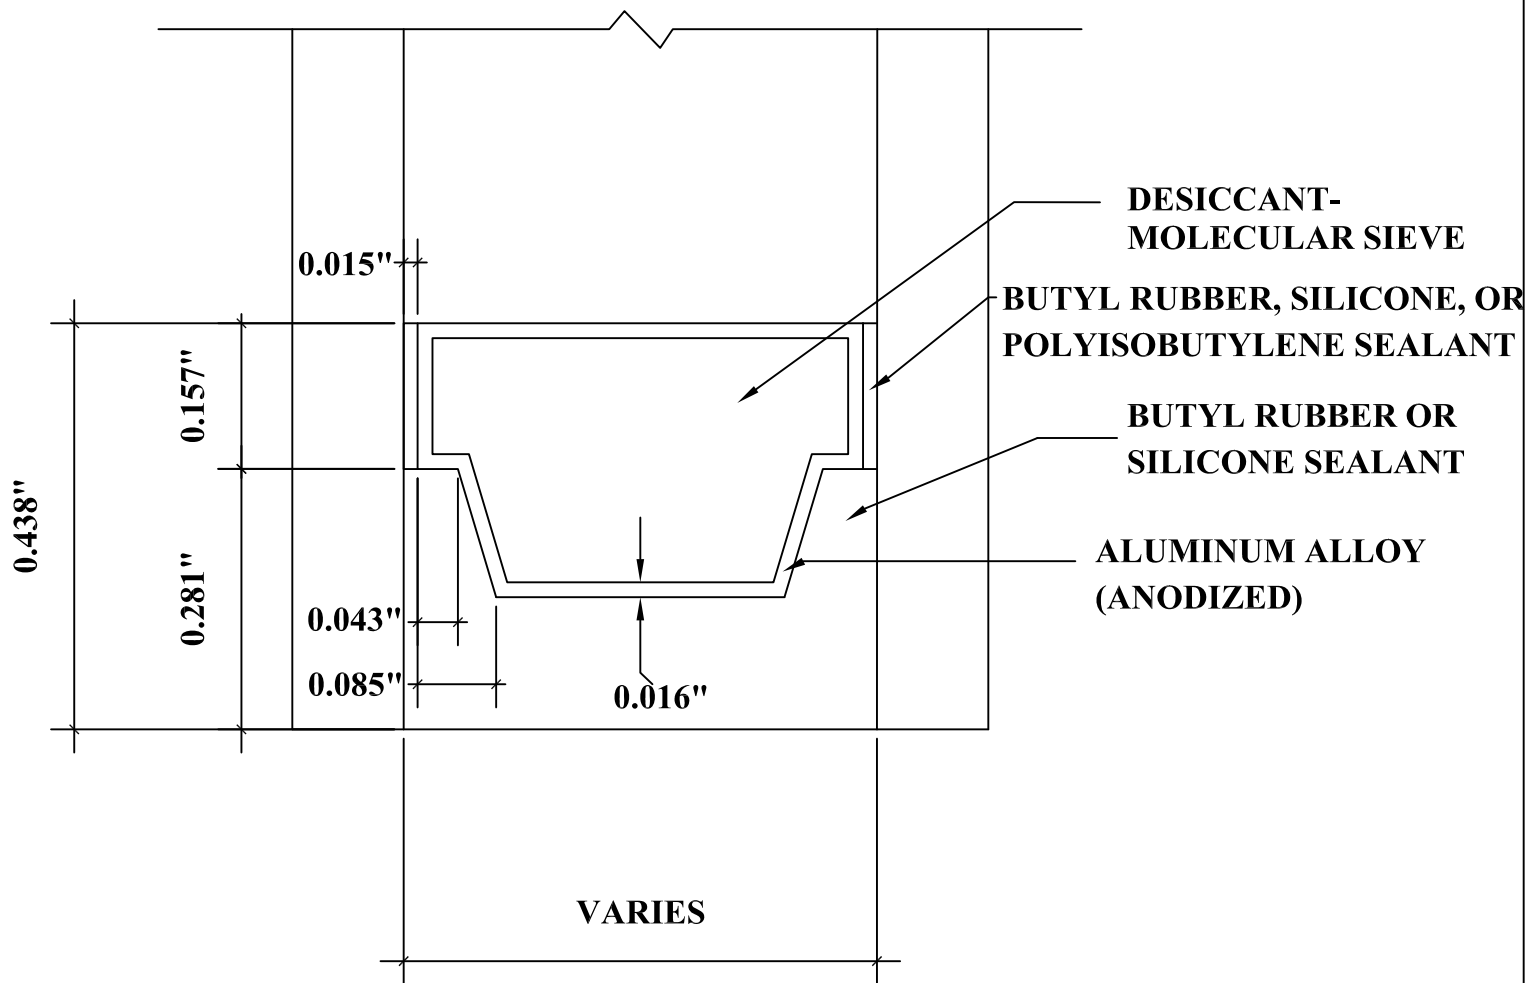

DETAIL FOR THERMAL MODELING OF  
ALUMINUM SPACER (A1-D)



Total Quality. Assured.

130 Derry Court  
York, Pennsylvania 17406

Telephone: 717-764-7700  
Facsimile: 717-764-4129  
[www.intertek.com/building](http://www.intertek.com/building)

## TEST REPORT FOR NEON ENERGY

Report No: P2837.01-116-45 R1

Date: 02/27/23

### SECTION 8

#### REVISION LOG

REVISION #	DATE	PAGES	REVISION
.01R0	11/30/22	All	Original report issued to Neon Energy.
.01R1	02/27/23	All	Fixed emissivity and boundary conditions on all models and updated results.